


inta

Thermal Balancing Valve 60040CP & 60041 CP Installation and Maintenance Instructions

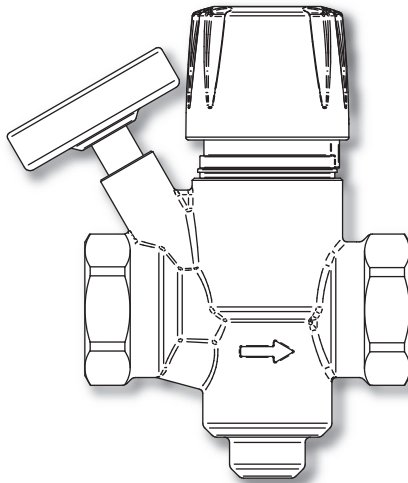

inta

Intatec Ltd

Airfield Industrial Estate
Hixon
Staffordshire
ST18 0PF

In this procedure document we have endeavoured to make the information as accurate as possible.

We cannot accept any responsibility should it be found that in any respect the information is inaccurate or incomplete or becomes so as a result of further developments or otherwise.

Tel: **01889 272 180**

Fax: **01889 272 181**

email: **sales@intatec.co.uk**

web: **www.intatec.co.uk**

Introduction

The Inta thermal balancing is used in domestic hot water distribution circuits to ensure that all sections are kept at the correct temperature and to balance the re-circulation network in order to avoid non-uniform temperature distribution.

The thermostatic regulator, installed on each branch of the recirculation circuit, automatically maintains the set temperature, granting the benefits of an anti-legionella treatment.

This device regulates the flow from the hot water calorifier and it is equipped with an adjusting knob to set the temperature and a temperature gauge in order to check any variance of the temperature.

Products

½" Thermal Balancing Valve	60040CP
¾" Thermal Balancing Valve	60041CP

Technical Specification


The conditions under which the valves will be operating must comply with the following;

Fluid:	Water
Accuracy:	±2°C
Max. static pressure:	10 bar
Max. dynamic pressure:	5 bar
Max. Inlet temperature:	90°C
Temperature adjustment range:	40 to 65 °C
Flow rate:	3 l/min
Kv:	1.5
WRAS approved product:	

Materials of Construction

Valve body:	DZR - BS EN 12165 CW625N
Springs:	Stainless steel
Seals:	EPDM Peroxide
Internal components:	DZR- BS EN 12165 CW625N
	Polymer - 20% reinforced
	Polymer - high strength

Dimensions

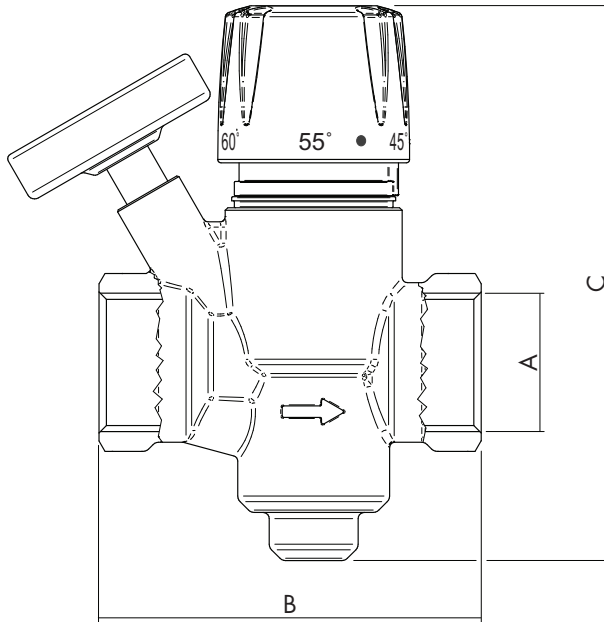


Code	A	B	C
60040CP	G $\frac{1}{2}$ "	70	113
60041C P	G $\frac{3}{4}$ "	73	113

Installation

To achieve equal distribution of hot water the valve has to reduce the flow in each branch of the system, regulating the flow as soon as the temperature reaches the set value.

The valve regulates the flow from the hot water calorifier and it is equipped with an adjusting knob to set the temperature and a thermometer in order to check any variance of the temperature.

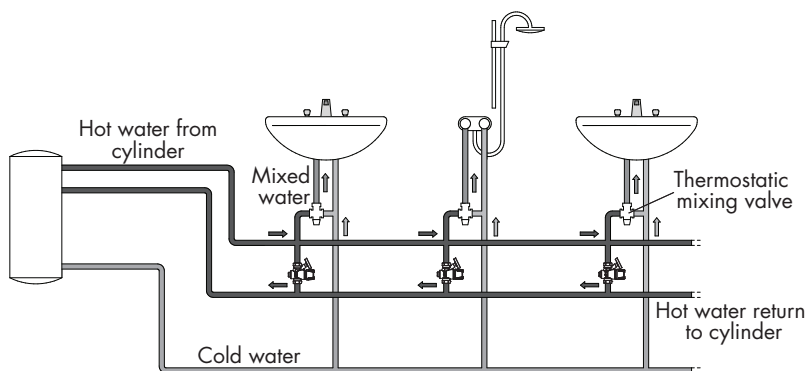

Before fitting the thermostatic balancing valve, the pipes must be thoroughly flushed to remove any debris or particles which will reduce its performance.

It is recommended to always install strainers of sufficient capacity at the inlet from the water main.

The valve can be fitted in any position by respecting the flow direction indicated by the arrow on the valve body.

The recirculation circuits are generally sized according to the flow rate required for each branch, based on the allowed heat dispersion and the corresponding decrease in temperature along the pipe.


Generally, the maximum allowable temperature drop between the point of departure from the calorifier and the point of return is 5°C and considering that the sum of the flows has to be higher than the minimum flow rate required by the valve.

Presetting


The valve can be preset using the adjusting knob by turning it until the required temperature corresponds with the indicator on the frame.

The valve can be locked at the preset temperature by:

- Unscrewing the retaining screw.
- Remove the knob by pulling away from the valve and repositioning on the splined shaft so that the internal slot locates on the position indicator on the frame.
- Refit and tighten the retaining screw.

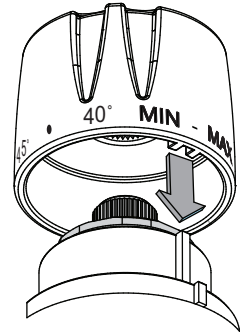

Sizing Chart

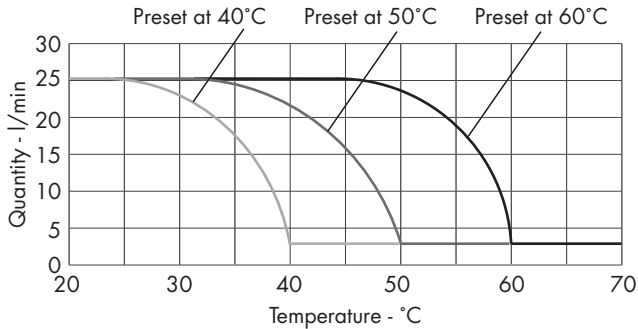

Notes:

Notes:

Please leave this Manual for the User

To activate your product warranty please visit

www.intatec.co.uk

and click on Product Registration

inta

Intatec Ltd

Airfield Industrial Estate

Hixon

Staffordshire

ST18 0PF

Tel: **01889 272 180**

Fax: **01889 272 181**

email: **sales@intatec.co.uk**

web: **www.intatec.co.uk**