


Butterfly Valve Nomenclature

F6	50	HD	SY2	-24	MFT	
Valve	Valve Size	Trim Material	Actuator Type	Power Supply	Control	
F6 = 2-way F7 = 3-way	50 = 2" 65 = 2½" 80 = 3" 100 = 4" 125 = 5" 150 = 6" 200 = 8" 250 = 10" 300 = 12" 350 = 14" 400 = 16" 450 = 18" 500 = 20" 600 = 24" 750 = 30"	HDU = Stainless Disc, Cast Ductile Iron Full Lug Body, EPDM Liner, Bubble Tight Close-Off to 50 psi HD = Stainless Disc, Cast Ductile Iron Full Lug Body, EPDM Liner, Bubble Tight Close-Off to 200 psi (2" to 12"), 150 psi (14"+) -150SHP = ANSI Class 150, Stainless Disc, Cast Steel Full Lug Body, RPTFE Seat, Bubble Tight Close-off up to 285 psi -300SHP = ANSI Class 150, Stainless Disc, Cast Steel Full Lug Body, RPTFE Seat, Bubble Tight Close-off up to 600 psi -VIC = Ductile Iron Grooved End Body, Nickel Coated Ductile Iron Disc, Bubble Tight Close-Off up to 300 psi	Non-Spring Return ARB(X) GRB(X) DR... N4 GR/GM... N4 GMB(X) SY Electronic Fail-Safe GK DKR...N4 Spring Return AF	-24 = 24 VAC/DC -110 = 110/120 VAC -120 = 120 VAC -230 = 230 VAC UP = 24-240 VAC or 24-125 VDC	Blank = On/Off -3-X1 = On/Off, Floating Point MFT or MFT-X1 = Multi-Function Technology	-S = Built-in Auxiliary Switch N4 = NEMA 4/4X N4H = NEMA 4 with heater


Ordering Example

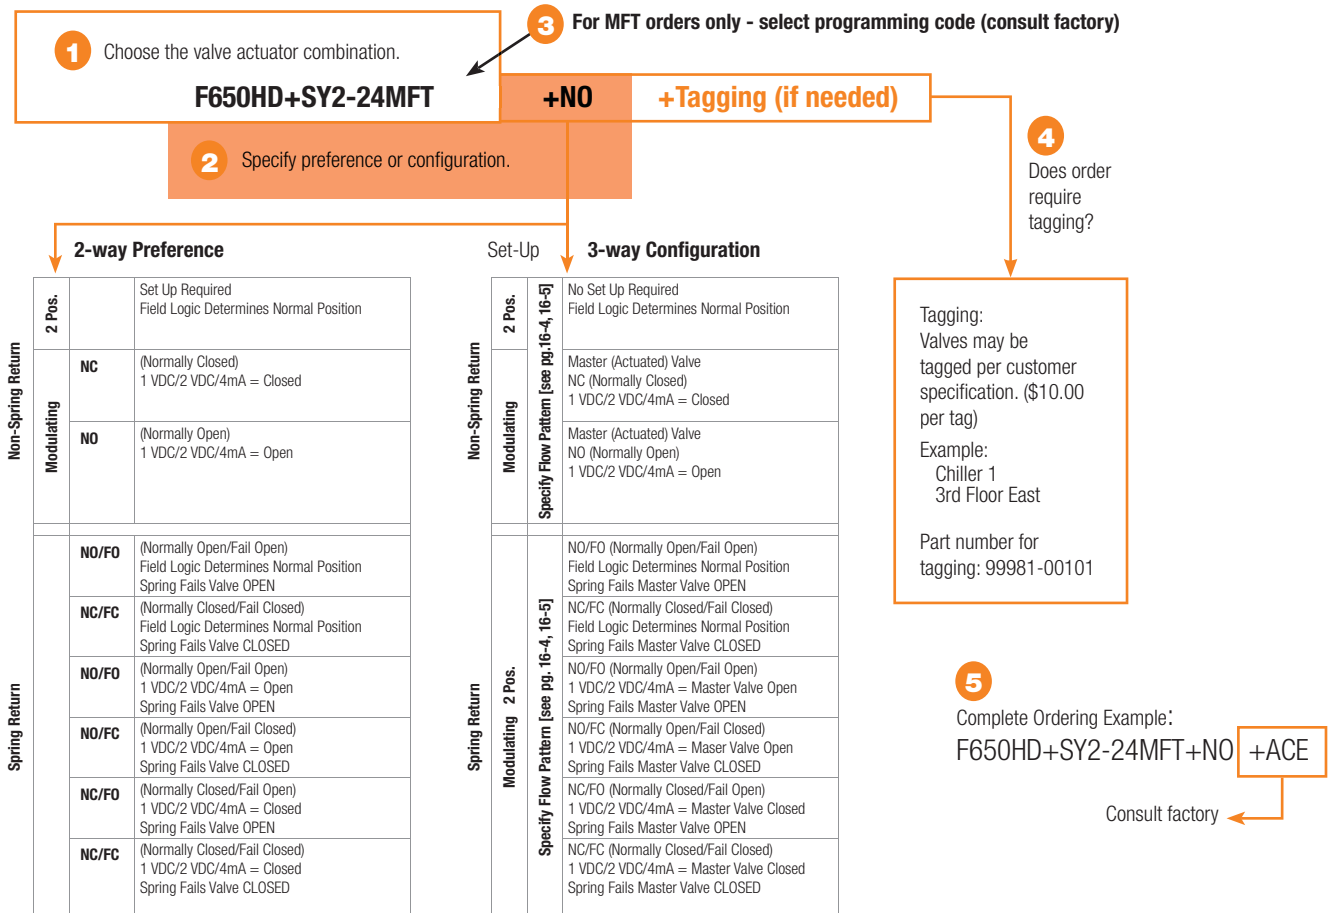

SHP Series Valves are Flow Direction Specific.

D145

MIXING
DIVERTING

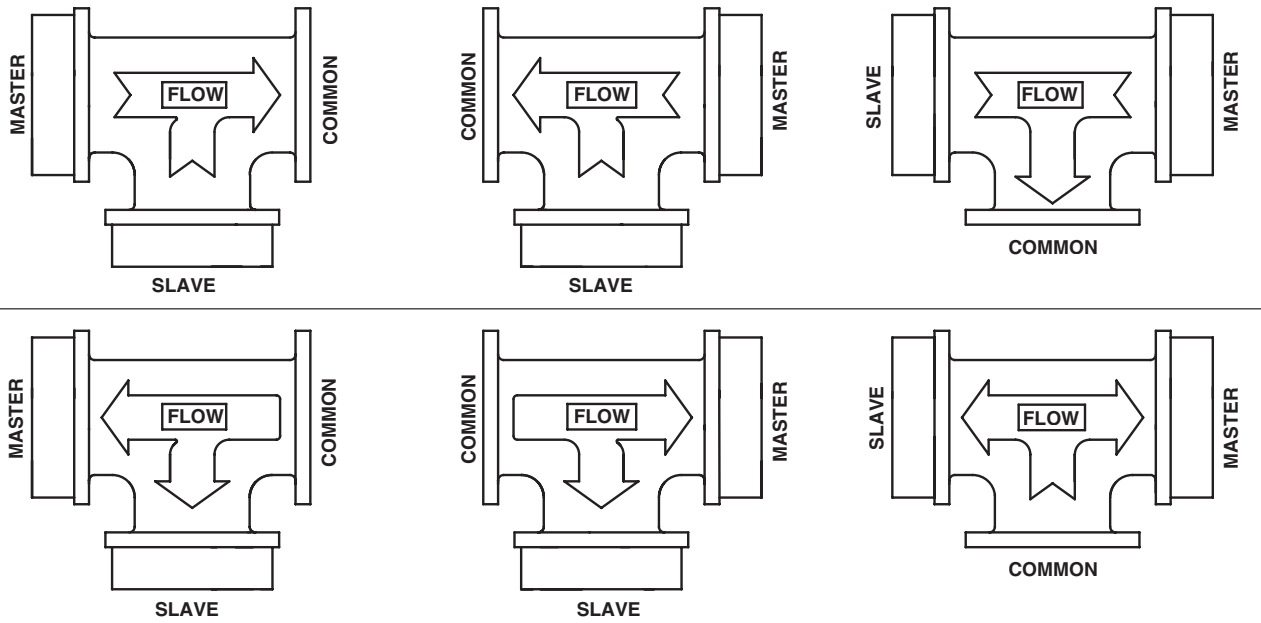

CONFIG CODE	ON/OFF OR MOD@2VDC MASTER VALVE IS	MASTER VALVE @ FAIL
M(D)10	OPEN	FAIL IN PLACE
M(D)11	OPEN	OPEN
M(D)12	OPEN	CLOSED
M(D)13	CLOSED	FAIL IN PLACE
M(D)14	CLOSED	OPEN
M(D)15	CLOSED	CLOSED

CONFIG CODE	ON/OFF OR MOD@2VDC MASTER VALVE IS	MASTER VALVE @ FAIL
M(D)20	OPEN	FAIL IN PLACE
M(D)21	OPEN	OPEN
M(D)22	OPEN	CLOSED
M(D)23	CLOSED	FAIL IN PLACE
M(D)24	CLOSED	OPEN
M(D)25	CLOSED	CLOSED

CONFIG CODE	ON/OFF OR MOD@2VDC MASTER VALVE IS	MASTER VALVE @ FAIL
M(D)30	OPEN	FAIL IN PLACE
M(D)31	OPEN	OPEN
M(D)32	OPEN	CLOSED
M(D)33	CLOSED	FAIL IN PLACE
M(D)34	CLOSED	OPEN
M(D)35	CLOSED	CLOSED

M Specifies MIXING, **D** Specifies DIVERTING

Notes:

1. Slave Valve operates inversely of the Master Valve.
2. The Master Valve is always located on the run.
3. The Slave Valve may also have an actuator if required (Direct Coupled).
4. On/Off actuator normal position is a function of field logic.
5. Proportional actuator normal position is a function of the CCW/CW switch.
6. All 3-way assemblies are designed for 90 degree actuator rotation.